

REQUEST FOR QUOTE
Concord Woods IT Room Sprinkler Upgrade

PLEASE PRINT

Name of Quoting Firm: _____

Address: _____

Phone Number: () _____

Fax Number: () _____

Questions About the Project:

All questions concerning the Project shall be referred to:

Lake Metroparks Representative/Project Manager	Contents of RFQ	Pages
Charles J. Kenzig, RLA	Quote form	3
11211 Spear Road, Concord Twp., Ohio 44077	Specifications	1
ckenzig@lakemetroparks.com	Drawing	1
Office (440) 639-7275		
Fax (440) 639-9126		

Submittal Deadline: February 13, 2012 at 12:00 PM by fax, email, or deliver your quote by the Submittal Deadline on this form to be considered for award.

Time of Completion

Completion shall be achieved **within 14 days from notice to proceed, but not later than: March 1, 2012.**

The Lake Metroparks is a governmental agency exempt from all local, state and federal taxes. No quote may be withdrawn before **Sixty (60)** days have elapsed after the quote has been submitted. Lake Metroparks intends to award this project to the lowest and best quote that is submitted in accordance with the requirements of these quote documents and does not exceed the funds available for the project. Every item line of the quote document must be filled in with a quoted price or acknowledgement of no quote. Each page of the quote document must be initialed and dated.

Requirements

Within five (5) consecutive calendar days of award of contract, successful quote must furnish Lake Metroparks with a Certificate of General Liability Insurance in the amount of \$1,000,000, naming "Lake Metroparks Board of Park Commissioners" Additional Insured by endorsement, and a current Certificate of Premium Payment from the Bureau of Workers' Compensation. Failure to furnish the required certificates within the time allowed will result in forfeiture of Quote.

The contractor shall adhere to all applicable health and safety laws and regulations including, but not limited to, those promulgated by the state and federal government.

SIGNATURE & BUSINESS INFORMATION

Company: _____

Title: _____

By: _____

(Print)

(Signature)

Company is: Individual Partnership Corporation

Federal Tax Payers I.D. Number or Owner's Social Security Number: _____

Residence of owner/president (If individual):

If owner/president is a partnership, fill in the following:

Names of Partners: _____

If owner/president is a corporation, fill in the following:

Organized under the laws of the State of _____

Name and address of President: _____

Name and address of treasurer: _____

Note: Persons signing this Quote Form on behalf of the company/corporation must attach to this quote form a copy of the corporate resolution authorizing the signature made on the corporation's behalf.

Subcontractors:

The owner/president shall list any anticipated Subcontractors he intends to use on the project.

Name & Address of Subcontractor: _____

Years in Business: _____

Name & Address of Subcontractor: _____

Years in Business: _____

Concord Woods IT Room Sprinkler Upgrade

Project scope:

The project includes the removal of one (1) side wall head and the installation of one (1) new side wall head and two (2) pendent heads.

Project details:

1. Contractor shall remove the existing side wall head in Room 118A completely back to main sprinkler line.
2. Contractor shall install new side wall head in center of wall per detailed dwg.
3. Where demolition work occurs, all abandoned openings shall be filled-in, and all disturbed surfaces shall be repaired or patched and prepared to receive finishes. Contractor shall repair drywall hole at location of demolished sprinkler and paint the repaired area. Note: paint to be provided by Owner.
4. Contractor shall be licensed by State of Ohio to perform sprinkler system modifications. Contractor shall coordinate with local fire department and State fire Marshall per Ohio Revised Code requirements. Contractor shall coordinate the shutdown and recharge of the sprinkler system with Lake Metroparks personnel so as not to disrupt continuous operation of office and shop functions.
5. Contractor shall be responsible for coordinating temporary shutdown of fire alarm system and any associated costs.
6. Permits have been secured and paid by Lake Metroparks for the project.
7. Contractor is responsible for verifying all dimensions, providing all components and fittings required for a complete installation.


Price Quote

Provide all work to upgrade sprinkler system in IT Rooms 118 & 118A per detailed drawings and specification.

Item 1

Item Description	Quantity	Total Price
Lump Sum total for complete project	1	\$


Company _____ Initials _____ Date _____

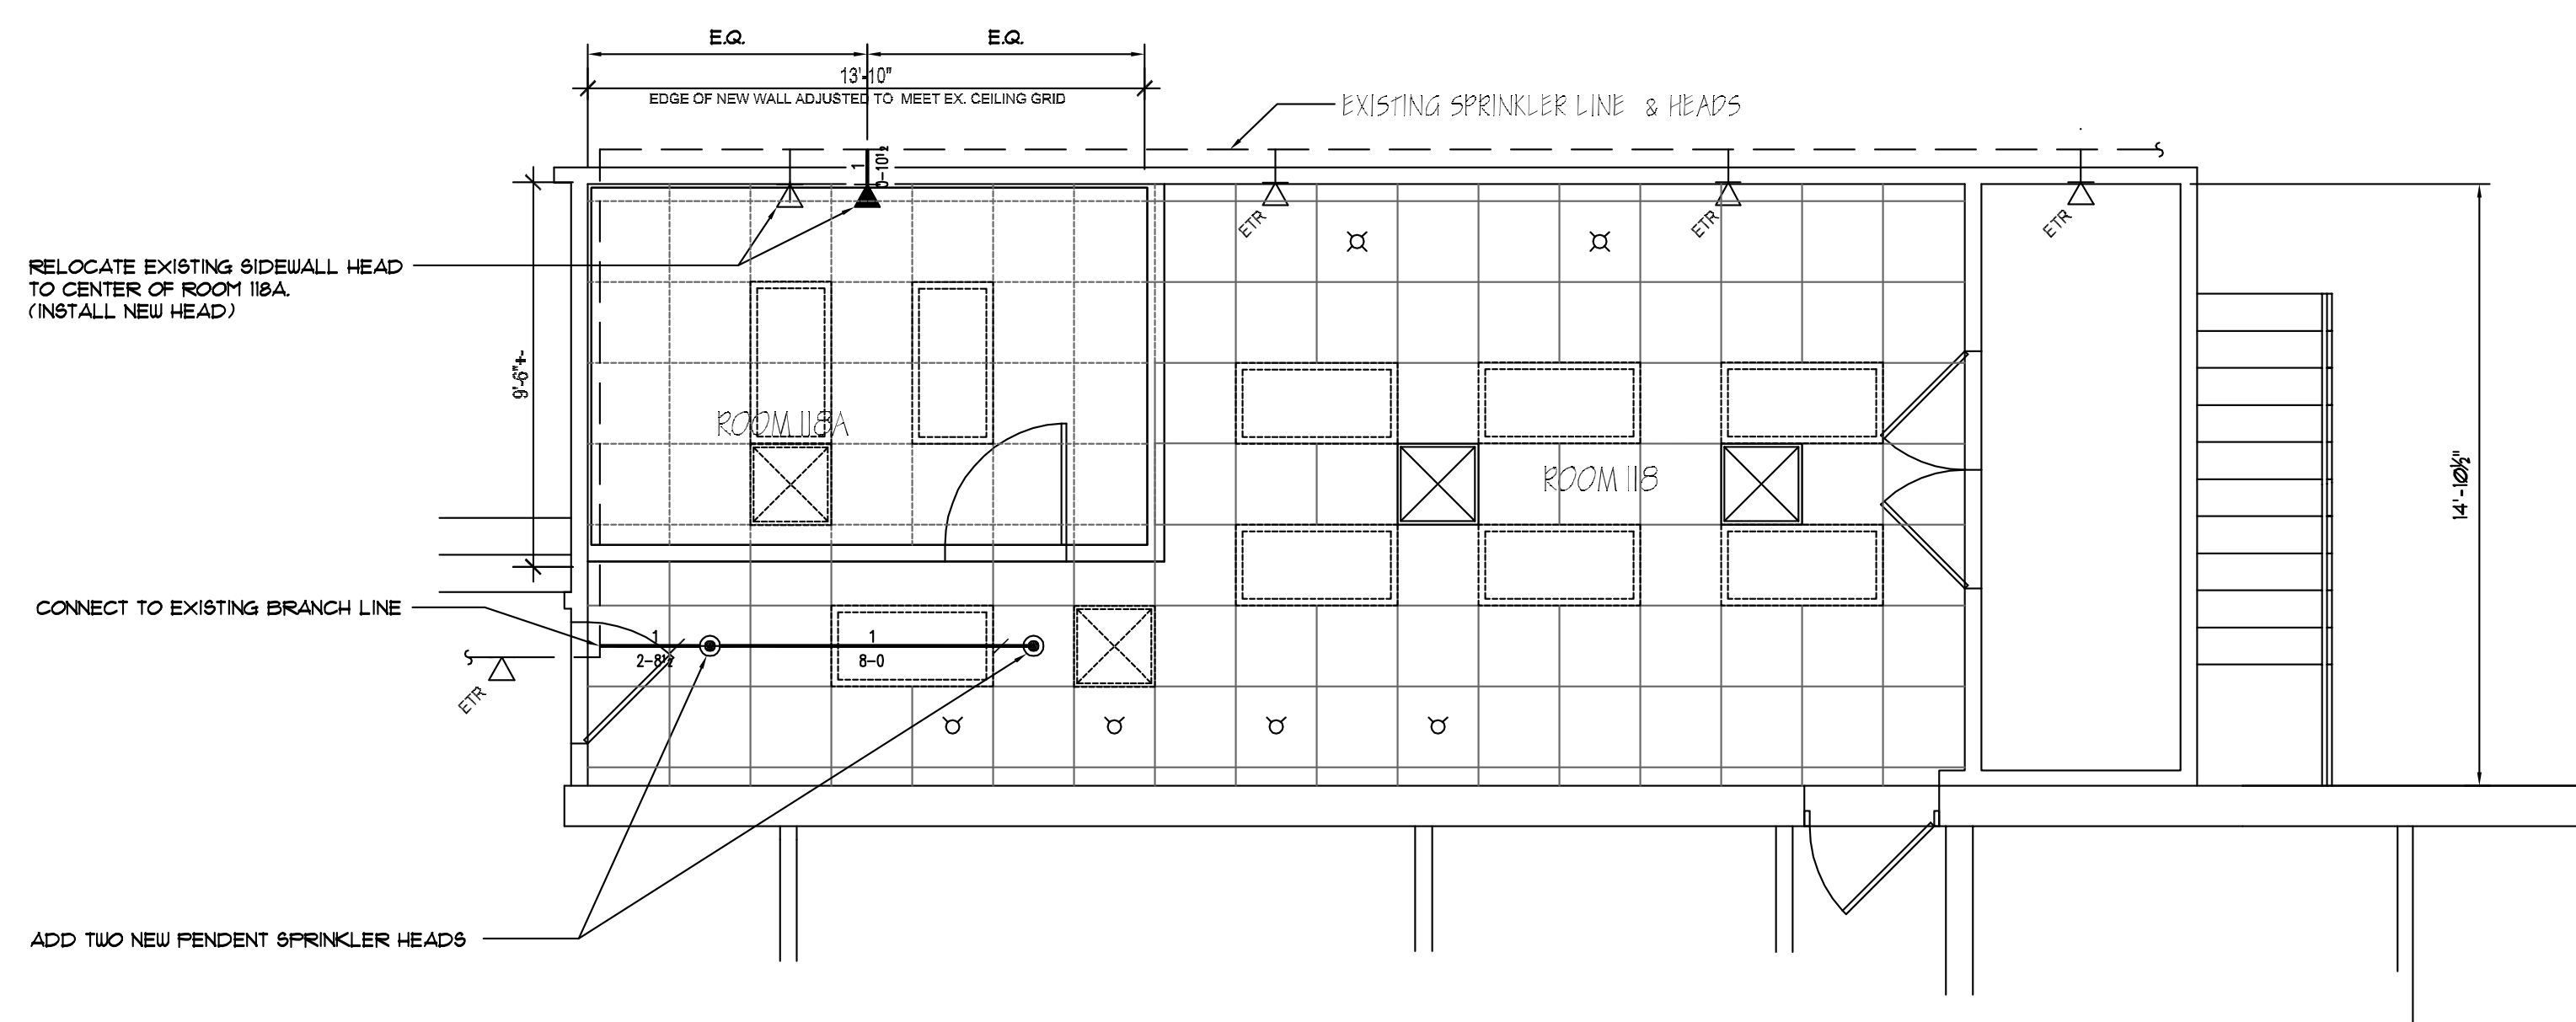



GENERAL NOTES

- + DENOTES FINISH FLOOR TO CENTER OF PIPE IN FEET AND INCHES.
* INDICATES CENTER OF PIPE FROM TOP OF STEEL (BOTTOM OF DECK) IN INCHES.
- HANGERS ARE TOP BEAM, A.T.R. AND PIPE RING, INTERMEDIATE HANGERS AS APPROVED BY N.F.P.A. 13.
- MATERIAL ARE AS FOLLOWS:
1" - 2" PIPE IS SCHED. 40 THREADED ENDS WITH C.I. FITTINGS.
2 1/2" PIPE AND LARGER IS THINWALL WITH VIC FITTINGS.
- ABBREVIATIONS ARE AS FOLLOWS:
C INDICATES CENTER
T INDICATES THREAD
G INDICATES GROOVE
P INDICATES PLAIN END
FLG INDICATES FLANGE
VMT INDICATES VIC MECHANICAL TEE
VMC INDICATES VIC MECHANICAL CROSS
- THIS OFFICE AREA IS DESIGNED LIGHT HAZARD. THIS SPRINKLER SYSTEM IS EXISTING. ADD TWO NEW HORIZONTAL SIDEWALL SPRINKLERS AS NOTED ON PLAN.
- ALL MATERIAL AND METHODS TO BE UL LISTED AND FM APPROVED.
- THESE DRAWINGS HAVE BEEN PREPARED BY

HYDROTECH FIRE PROTECTION

Christopher J. Eddy

 CHRISTOPHER J. EDDY
 OHIO CERTIFIED SPRINKLER DESIGNER No. 2926

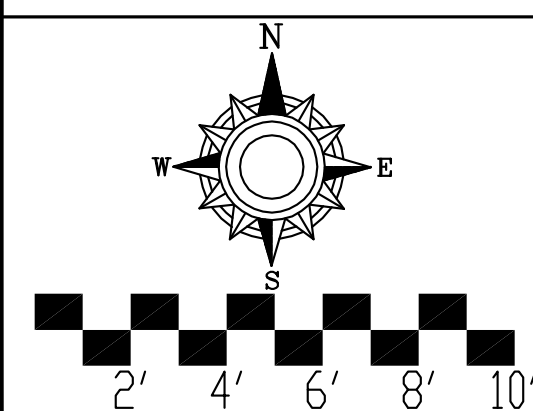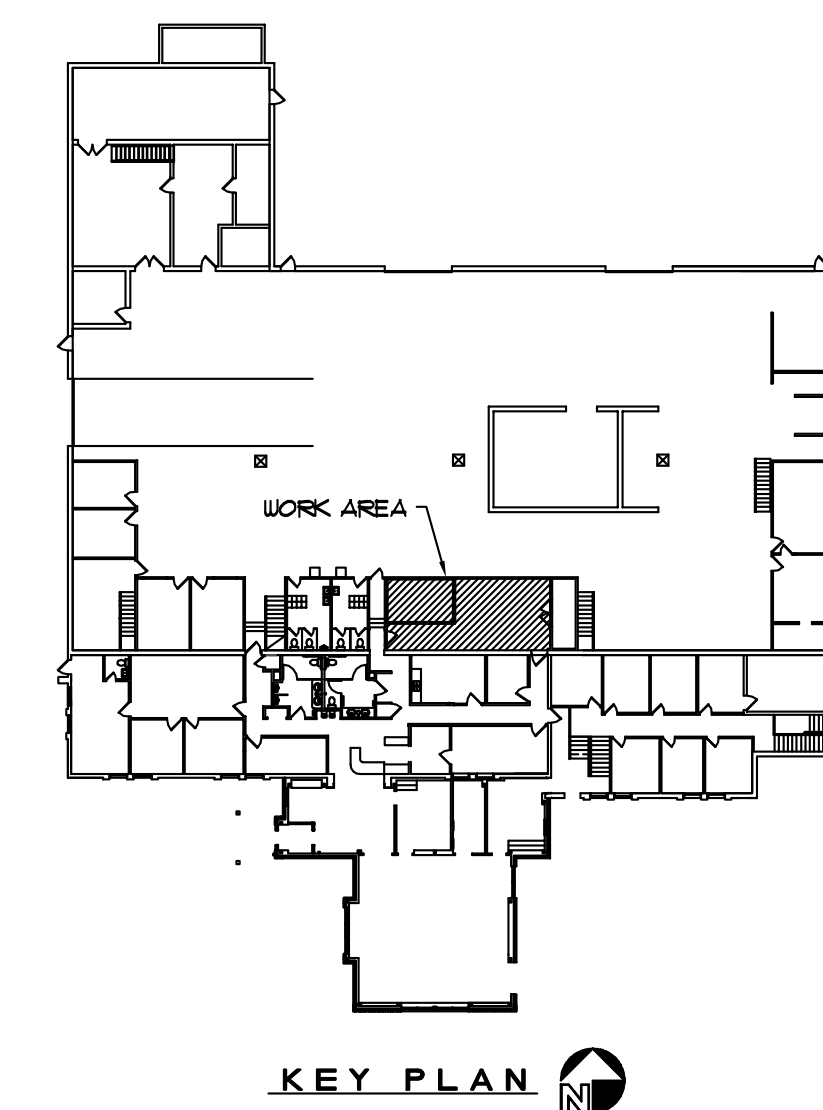ADD OR RELOCATE HEADS IN OFFICES




NOTES

REVISIONS		
DATE	DESCRIPTION	BY
11/02/11	REVISION No.1, ADD TWO NEW SIDEWALL HEADS TO ROOM 118A AND 118 AS NOTED.	CJE
01/09/12	REVISION No.2, ADD SHEET FP-2 REMOVE 1 NEW SIDEWALL, ADD 2 PENDENT HDS.	CJE

SPRINKLER SYMBOLS

USE THESE SPRINKLER HEADS OR EQUAL

SYM	CNT	POSITION	FINISH	TEMP	K	NPT	SIZE	MFG.	MODEL#
⊙	2	PEND	CHROME	155	5.60	1/2"	TY3231	TYGD	TY-FRB
▷	1	HSW	CHROME	155	5.60	1/2"	TY3331	TYGD	TY-FRB

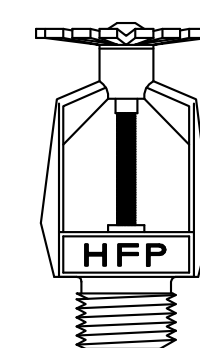

GENE PTACEK AND SON, INC.
 7310 ASSOCIATE AVE.
 CLEVELAND, OHIO 44144

CONTRACTOR: 216.651.8300

LAKE METRO PARKS
 11211 SPEAR ROAD
 CONCORD TWP., OHIO 44077

PROJECT:

SPRINKLER PLAN OFFICES

PERMIT NO.	
CONTRACT NO.	11145
APPROVAL	LOCAL
DRAWN BY	Chris Eddy
SCALE	1/4" = 1'-0"
DATE	01/09/12
REVISED	
PLOTTED	FP 1 of 1

3 TOTAL NEW WET SPRINKLERS THIS SHEET